



T2428100 Open Frame Transformer

Specification Chart:


Model #	Input (Primary)	Output (Secondary)	Agency Listing
T2428100	115VAC, 50/60Hz, 1A	24VAC/100VA (4A) or 28VAC/100VA (3.5A)	

Installation Instructions:


1. Mount transformer in the desired location/enclosure (*refer to Transformer Drawing and Dimensions below*).
2. Connect AC power 115VAC, 50/60Hz to primary leads (black and white) (*refer to Wiring Configuration below*).
3. Measure output voltage across the secondary leads before connecting devices (*refer to Wiring Configuration below*).
This helps avoiding potential damage.
 - Yellow and Brown for 24VAC (open circuit voltage @ 115VAC approx. 26.1VAC).
 - Black and Brown for 28VAC (open circuit voltage @ 115VAC approx. 30.4VAC).
4. Connect 24VAC device(s) to Yellow and Brown leads or 28VAC device(s) to Black and Brown leads (*refer to Wiring Configuration below*).

WARNING: This installation should be made by qualified service personnel and should conform to the National Electrical Code and all local codes.

Wiring Configuration:

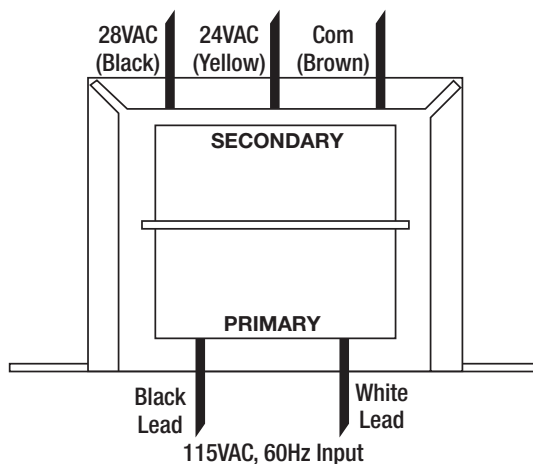

Transformer Drawing and Dimensions:

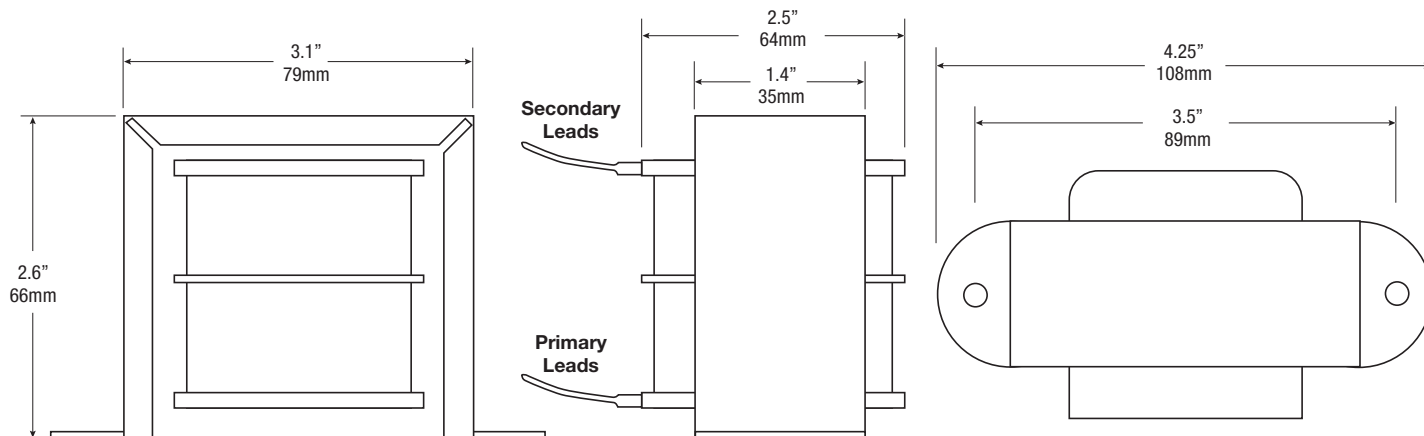

Altronix is not responsible for any typographical errors. Product specifications are subject to change without notice.

140 58th Street, Brooklyn, New York 11220 USA | phone: 718-567-8181 | fax: 718-567-9056
 website: www.altronix.com | e-mail: info@altronix.com
 IIT2428100 - Rev. 051612

107U

